



GEOTECHNICAL & MATERIALS
ENGINEERING, TESTING & INSPECTION

P.O. BOX 15732 • TAMPA, FLORIDA 33684 • 813/872-7821 CA No. 1450

PROJECT: FDOT Product Check


CLIENT: Pasco Mine

LIMEROCK BEARING RATIO TEST
TEST METHOD: FDOT FM 5-515

PROJECT NO: 1505.25.1

DATE: January 7, 2026

LAB NO: B-15903

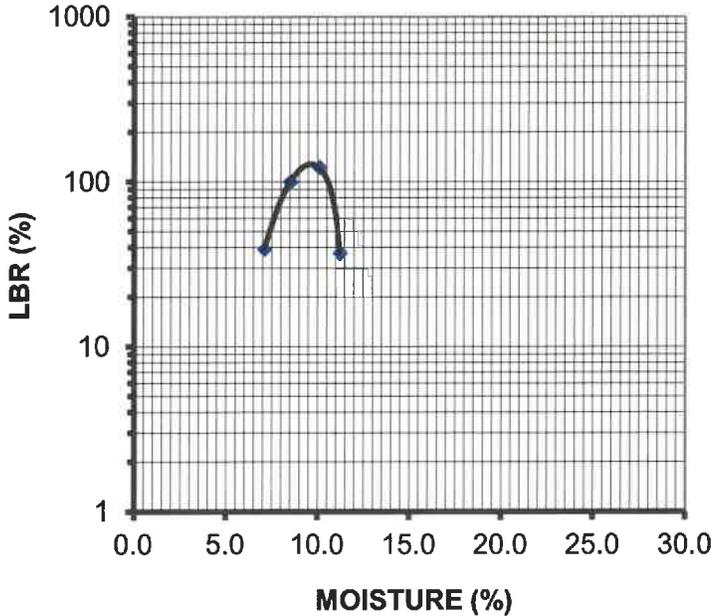

LBR TEST NO: 3

COMPACTION TEST NO.: 3

MAXIMUM LBR VALUE (%): 125

MAXIMUM DRY DENSITY (PCF): 122.4

OPTIMUM MOISTURE (%): 10.0

DATE SAMPLED: 12/11/25


SAMPLED BY: CB

DATE TESTED: 01/02/26

TESTED BY: MD

LOCATION SAMPLED: Stockpile #5, Sample #2

SOIL DESCRIPTION: Crushed Limerock

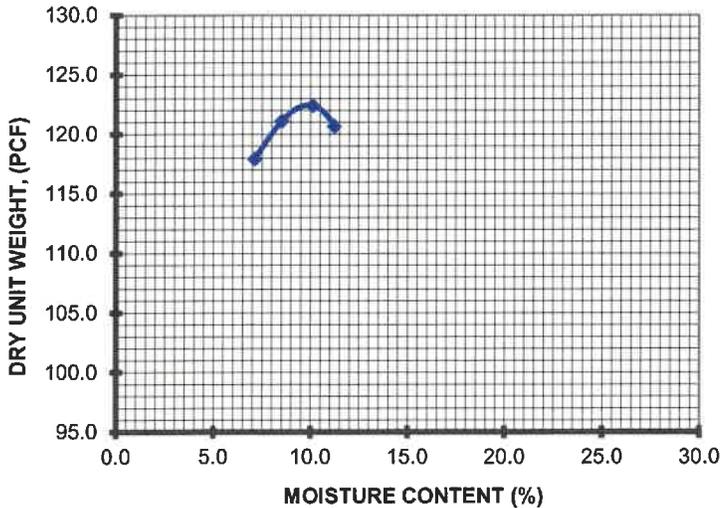


TYPE OF MATERIAL: Base

SOAKING TIME (HRS): 48±4

SOAKING SURCHARGE (LBS): 2.5

TESTING SURCHARGE (LBS): 0

REMARKS: MAC No. 2602036739
Sample No. 255001

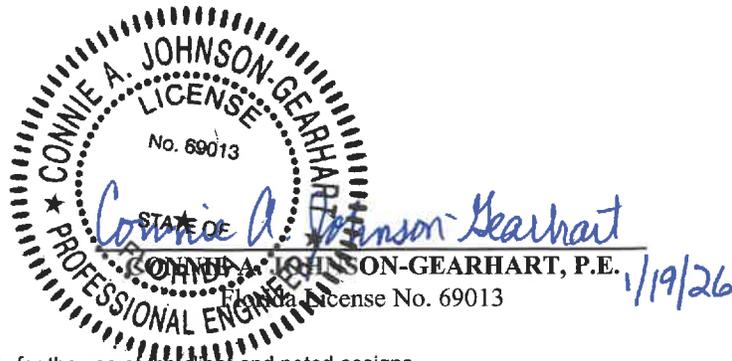

This report contains information that is intended solely for the use of the client and noted assigns.
This report shall not be reproduced, except in full, without written approval of Test Lab, Inc.